


When duct work is located outside the building a minimum R-8 value is required.
2014 OEEESC 503.2.7

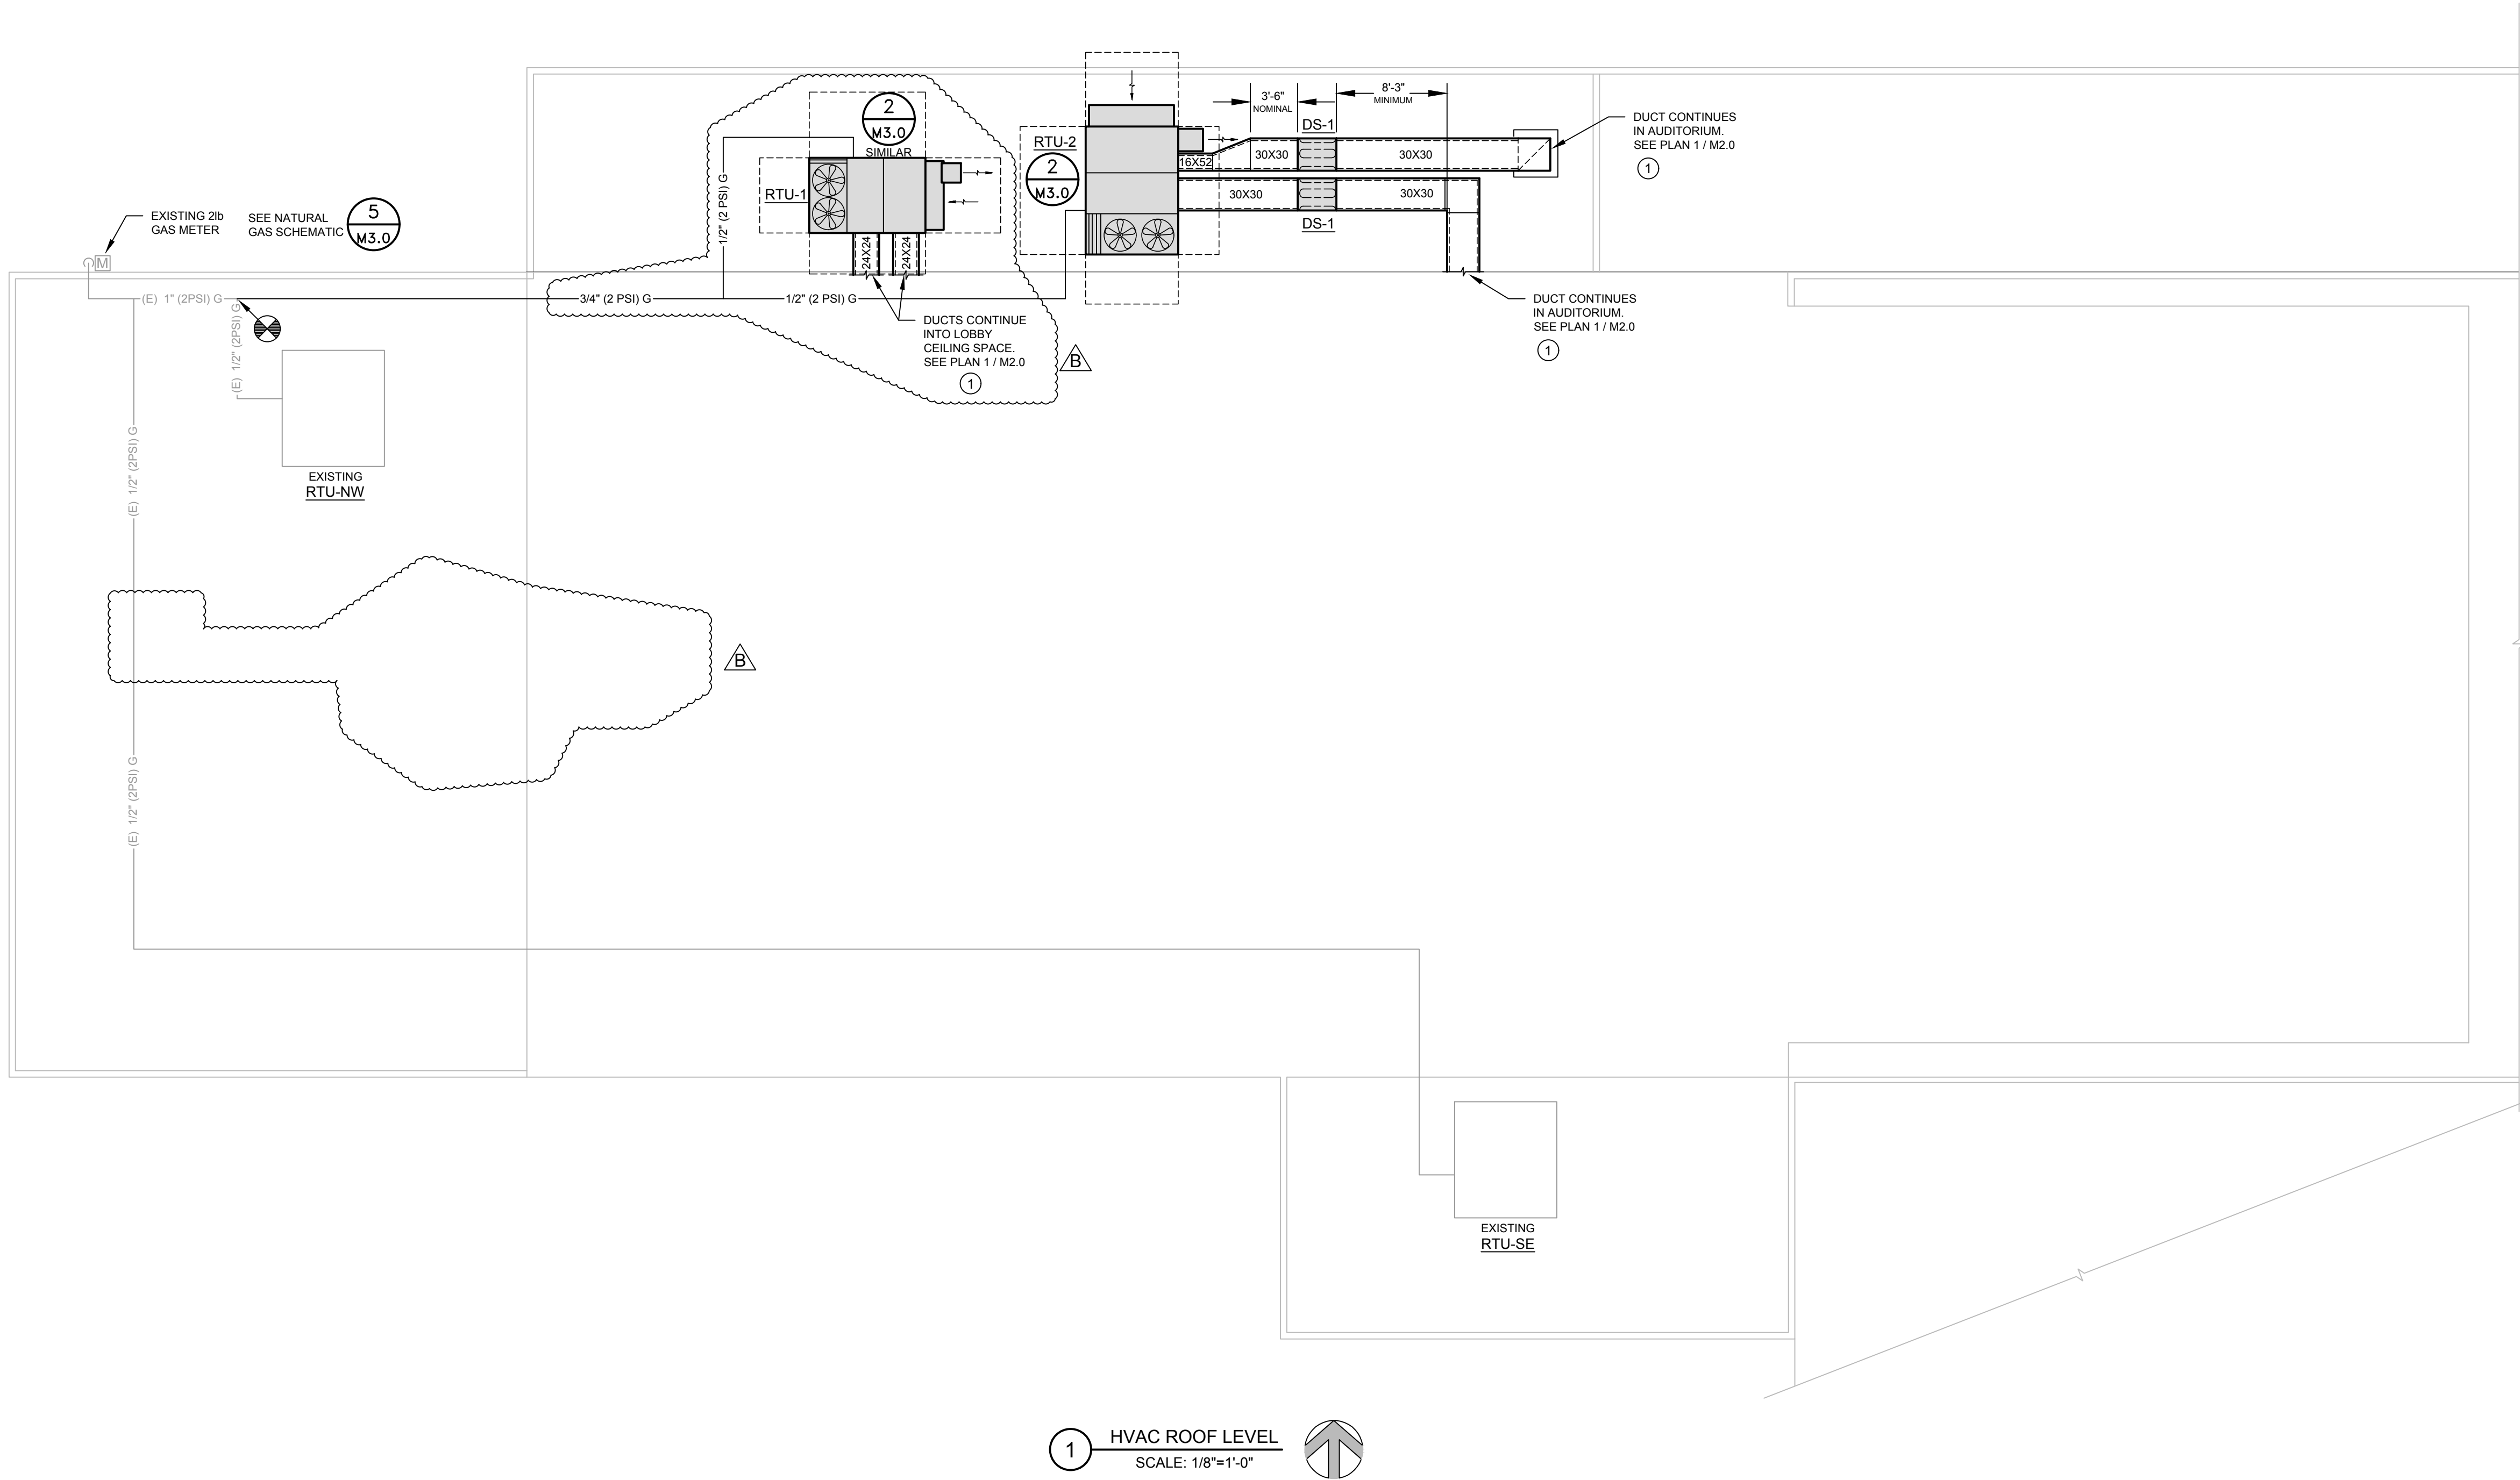

KEYED NOTES

1.

SEAL PENETRATION WATER TIGHT, ROOF FLASHING BY OTHERS.
SEE ARCHITECTURAL.

REV	BY	REVISION	DATE
B	RGM	STRUCT., ARCH., & VE REVISIONS	19JAN18



COMFORT FLOW HEATING

AND AIR CONDITIONING

1951 Don Street | Springfield, OR 97477

OFFICE: (541) 726-0100 | FAX: (541) 725-4799

www.comfortflow.com

Engineering, Design, Budgeting, Installation & Service

ALL RIGHTS RESERVED.
NO PART OF THIS DOCUMENT
MAY BE USED, REPRODUCED OR
TRANSMITTED IN ANY FORM OR BY
ANY MEANS, ELECTRONIC OR
MECHANICAL, WITHOUT WRITTEN
PERMISSION FROM
THE ENGINEERING DEPARTMENT OF
COMFORT FLOW HEATING.

SUMMIT CREEK CHURCH

275 WEST 5th AVE.

EUGENE, OREGON

PROJECT TYPE:

HVAC
ROOF
LEVEL

DRAWN BY:

RGM DRAFTING

DESIGNED BY:

JE / CMP

CHECKED BY:

CMP

FILE NAME:

SCC-M

PROJECT NO:

DRAWING SCALE:

AS NOTED

DATE:

09OCT17

PLOT SCALE:

1-1

REV:

B

SHEET:

6 OF 7

SHEET NO:

M2.1